

Approvals Document












Rosemount™ 8600 Vortex Flowmeter



Rosemount 8600™ Vortex Flow Meter Global Certificate Summary

| Order Code | 8600 Vortex Flow Meter Ratings | Region | Agency | Certification Number |
|---|---|----------------------------|-----------------|-----------------------------------|
| - | Ordinary Location * | USA, CU** Canada, EU | CSA or EAC | 80102918 (CSA) |
| E6 K6 | Explosionproof-Intrinsically Safe (Class I, Division 1) Flameproof-Intrinsically Safe (Class I, Zone 1) Dust Ignitionproof (Class II and III, Division 1) | USA, Canada | CSA | 80102918 |
| I6, IF K6 | Intrinsically Safe (Class I, II, III, Division 1) Entity; Intrinsically Safe (Class I, Zone 0) Non-Incendive (Class I, Division 2) | USA, Canada | CSA | 80102918 |
| E7, K7 | Flameproof Enclosure and/or Intrinsically Safe | Global | DEKRA | IECEX KEM 11.0022X |
| I7, K7 | Intrinsic Safety | Global | Baseefa | IECEX BAS 12.0053X |
| N7, K7 | Non-Sparking (Type n) | Global | Baseefa | IECEX BAS 12.0054X |
| NF, K7 | Protection by Enclosure (Ex tb) (Dust) | Global | Baseefa | IECEX BAS 17.0018X |
| E1, K1 | Flameproof Enclosure and/or Intrinsically Safe | EU | DEKRA | DEKRA12ATEX0189 X |
| I1, K1 | Intrinsic Safety | EU | Baseefa | Baseefa12ATEX0179X |
| N1, K1 | Non-Sparking (Type n) | EU | Baseefa | Baseefa12ATEX0180X |
| ND, K1 | Protection by Enclosure (Ex tb) (Dust) | EU | Baseefa | Baseefa17ATEX0019X |
| E2, K2 | Flameproof Enclosure and/or Intrinsically Safe | Brazil | DNV- INMETRO | DNV 20.0054 X |
| I2, K2 | Intrinsic Safety | Brazil | DNV- INMETRO | DNV 20.0053 X |
| E4 | Flameproof, Intrinsic Safety | Japan | CML | CML xxxxx *** |
| EP, E9 | Flameproof | Korea | KTL | certificate numbers vary |
| E3, K3 | Flameproof Enclosure and/or Intrinsically Safe | China | NEPSI | GYJ21.1293X |
| I3, K3 | Intrinsic Safety | China | NEPSI | GYJ22.1852X |
| N3, K3 | Increased Safety (Ex ec) | China | NEPSI | GYJ22.1853X |
| -, K3 | Protection by Enclosure (Ex tD) (Dust) | China | NEPSI | GYJ22.1854X |
| E8, I8, N8, K8 | Flameproof, Intrinsic Safety, Type n, | Russia** | HAHIO ЦCBЭ | EAЭC RU C- US.AA87.B.00394 |
| EW, KW | Flameproof | India | PESO | A/P/HQ/MH/104/7105 (P531032/1) |
| IW, KW | Intrinsic Safety | India | PESO | A/P/HQ/MH/104/7106 (P531035/1) |
| | | | | |
| * Complies with only the local country product safety, electromagnetic, pressure and other applicable regulations. Cannot be used in a classified or zoned hazardous location environment. No ordering code required. | | | | |
| ** Customs Union (Russia, Belarus and Kazakhstan) | | | | |
| *** Planned submittal or in process with Agency. | | | | |
| **** Where "X" will vary depending upon the factory location and specific certification. | | | | |

Approval Markings and Logos

| Symbol | Marking or Symbol Name | Region | Meaning of Marking or Symbol |
|---|---------------------------|---|---|
|  | CE | European Union | Compliance with all applicable European Union Directives. |
|  | UKCA | UK | Compliance with all applicable UK Regulations 2016 requirements. |
|  | ATEX | European Union | Compliance with Equipment and Protective systems intended for use in Potentially Explosive Atmospheres: directive (ATEX) (2014/34/EU) |
|  | C-tick | Australia | Compliance with Australian applicable electromagnetic compatibility standards |
|  | CSA | US = United States C = Canada | Indicates that the product was tested and has met the applicable certification requirements for the noted countries. |
|  | Eurasian Conformity (EAC) | Eurasian Customs Union (Russia, Belarus and Kazakhstan) | Compliance with all the applicable technical regulations of the EAC Customs Union |
|  | EAC Hazardous Location | Eurasian Customs Union (Russia, Belarus and Kazakhstan) | Compliance with Technical regulation, (TR CU 012/2011) – The safety of equipment for use in explosive environments. |
|  | Russian Pattern Approval | Russia | Indicates compliance of measuring instruments with the approved metrological and technical characteristics. |
|  | DNV GL - INMETRO | Brazil | Compliance with all the applicable technical regulations of Brazil. |
|  | NEPSI | China | Compliance with all the applicable technical regulations of China. |
|  | KTL | Korea | Compliance with all the applicable technical regulations of Korea. |

Product designated for Ordinary Location may be marked with CE, C-tick, CSA and/or EAC logos.

US and Canadian Certifications

Canadian Standards Association - CSA Certificate: 80102918

CLASS 2252-05 - PROCESS CONTROL EQUIPMENT

CLASS 2252-85 - PROCESS CONTROL EQUIPMENT – Certified to US Standards

Ordinary Location Certification:

Vortex Flowmeter, Model 8600D with integral or remote mount flow sensor, with or without LCD meter, with or without transient protection, with or without temperature option (see model number structure below), permanently connected, rated 42 Vdc max, 4-20 mA output, 42 Vdc max MODBUS RS-485 output, or 32 Vdc max Fieldbus output. The 8600D is rated “Dual Seal” up to a MWP 740PSI. Enclosure ratings: Type 4X, IP66. Ambient Temperature: -50°C to +70°C. Process Temperature: -40°C to +232°C, see Conditions of Acceptability.

Model Number Structure:

8600Dabcdefghi Vortex Flowmeter

a = Meter Style: F

b = Line Size: 010 (1.0 inch) up to 080 (8 inch)

c = Wetted Materials: S

d = Flange/Alignment Ring Code: Any two-digit alpha numeric characters

e = Sensor Process Temperature Range: N

f = Conduit Entry and Housing Material: 1 or 2

g = Transmitter Output: D, P F, or M

h = Calibration: 0 or 1

i = Options: Any alpha-numeric characters representing product options up to forty-eight digits. Includes Safety Approval Code Option: **blank** (ordinary location)

Certification Notes:

1. The above model is permanently connected, Pollution Degree 2, Installation Category II.
2. Mode of operation: Continuous
3. Environmental Conditions: Extended: -50°C to +70°C, 2000 m max, 0-95% rH as specified by manufacturer.

Conditions of Acceptability:

1. The process temperature shall be taken into consideration during installation, in order to ensure that the flowmeter transmitter ambient temperature rating of -50°C to +70°C is maintained. Elevated maximum process temperatures entail remote mounting.

CLASS 2258-02 - PROCESS CONTROL EQUIPMENT - For Hazardous Locations

CLASS 2258 82 - PROCESS CONTROL EQUIPMENT - For Hazardous Locations –To US Requirements

Vortex Flowmeter, model 8600D with integral or remote mount flow sensor, with or without LCD meter, with or without transient protection, with or without temperature option (see model number structure below), permanently connected, rated 42 Vdc max, 4-20 mA output, 42 Vdc max MODBUS RS-485 output, or 32 Vdc max Fieldbus output, intrinsically safe when connected per drawing 08800-0112. The 8600D is rated “Dual Seal” up to a MWP 740PSI. Enclosure ratings: Factory Sealed, Type 4X, IP66. Ambient Temperature: -50°C to +70°C. Process Temperature: -40°C to +232°C, see Conditions of Acceptability

Order Code E6

Class / Divisions:

Explosion-Proof (XP) for Class I, Division 1, Groups B, C, and D. Factory Sealed; Temperature Class T6; Ta = -50 °C ≤ Ta ≤ 70 °C

Dust ignition-proof (DIP) for Class II, III Division 1, Groups E, F, G. Temperature Class T6; Ta = -50 °C ≤ Ta ≤ 70 °C

Dual Seal up to MWP 740 PSI; Enclosure Type 4X; Install per drawing 08800-0112

Class / Zones:

Ex db [ia] IIC T6...T2 Gb (-50 °C ≤ Ta ≤ 70 °C)

Class I, Zone 1, AEx db [ia] IIC T6...T2 Gb (-50 °C ≤ Ta ≤ 70 °C)

Install per drawing 08800-0112; IP66

Model Number Structure:

8600Dabcdefghi Vortex Flowmeter

a = Meter Style: F

b = Line Size: 010 (1.0 inch) up to 080 (8 inch)

c = Wetted Materials: S

d = Flange/Alignment Ring Code: Any two-digit alpha numeric characters

e = Sensor Process Temperature Range: N

f = Conduit Entry and Housing Material: 1 or 2

g = Transmitter Output: D, P, F, or M (M not for K6)

h = Calibration: 0 or 1

i = Options: Any alpha-numeric characters representing product options up to forty-eight digits. Includes Safety Approval Code Options: **E6** or **K6**

Certification Notes:

1. The above model is permanently connected, Pollution Degree 2, Installation Category II.
2. Mode of operation: Continuous
3. Environmental Conditions: Extended: -50°C to +70°C, 2000 m max, 0-95% rH as specified by manufacturer.

Conditions of Acceptability:

1. The Flowmeter shall be provided with special fasteners of property class A2-70 or A4-70.
2. For information regarding the dimensions of the flameproof joints the manufacturer shall be contacted.
3. When fitted with the 90V transient suppressors, the equipment is not capable of passing the 500V insulation test. This must be taken into account upon installation.
4. The process temperature shall be taken into consideration during installation, in order to ensure that the flowmeter transmitter ambient temperature rating of -50°C to +70°C is maintained. Elevated maximum process temperatures entail remote mounting.
5. Units marked with "Warning: Electrostatic Charging Hazard" may use non-conductive paint thicker than 0.2mm. Precautions shall be taken to avoid ignition due to electrostatic charge on the enclosure.
6. For the Ex db version of the 8600D series, the temperature classification is dependent upon the following process temperatures:

| Ambient temperature (°C) | Process temperature (°C) | T-Class |
|--------------------------|--------------------------|---------|
| -50 to +70 | -50 to +75 | T6 |
| -50 to +70 | -50 to +95 | T5 |
| -50 to +70 | -50 to +130 | T4 |
| -50 to +70 | -50 to +195 | T3 |
| -50 to +70 | -50 to +250 | T2 |

CLASS 2258-03 - PROCESS CONTROL EQUIPMENT - Intrinsically Safe and Non-Incendive Systems - For Hazardous Locations

CLASS 2258-83 - PROCESS CONTROL EQUIPMENT - Intrinsically Safe and Non-Incendive Systems - For Hazardous Locations - Certified to US Requirements.

Vortex Flowmeter, Model 8600D with integral or remote mount flow sensor, with or without LCD meter, with or without transient protection, with or without temperature option (see model number structure below), permanently connected, rated 30 Vdc max, 4-20 mA or Fieldbus output, intrinsically safe when connected per drawing 08800-0112. The 8600D is rated "Dual Seal" up to a MWP 740PSI. Enclosure ratings: Type 4X, IP66. Ambient Temperature: -50°C to +70°C, or -50°C to +60°C for Fieldbus. Process Temperature: -40°C to +232°C, see Conditions of Acceptability

Order Code I6

Class / Divisions:

IS: Class I, II, III Division 1, Groups A, B, C, D, E, F, G;

Non-incendive for Class I, Division 2, Groups A, B, C and D

Temperature Code T4: (-50 °C ≤ Ta ≤ 70 °C) 4-20 mA HART; (-50 °C ≤ Ta ≤ 60 °C) Fieldbus

Install per drawing 08800-0112, Dual Seal up to MWP 740 PSI; Enclosure Type 4X

Class / Zones:

Ex ia IIC T4 Ga

Class I, Zone 0, AEx ia IIC T4 Ga

Temperature Code T4: (-50 °C ≤ Ta ≤ 70 °C) 4-20 mA HART; (-50 °C ≤ Ta ≤ 60 °C) Fieldbus

Install per drawing 08800-0112, Dual Seal up to MWP 740 PSI; IP66

Model Number Structure:

8600D-abcdefghi Vortex Flowmeter

a = Meter Style: F

b = Line Size: 010 (1.0 inch) up to 080 (8 inch)

c = Wetted Materials: S

d = Flange/Alignment Ring Code: Any two-digit alpha numeric characters

e = Sensor Process Temperature Range: N

f = Conduit Entry and Housing Material: 1 or 2

g = Transmitter Output: D, P, or F

h = Calibration: 0 or 1

i = Options: Any alpha-numeric characters representing product options up to forty-eight digits.

Includes Safety Approval Code Options: **I6** or **K6**

Combined North America Certifications K6: Combination of E6 and I6.

CSA Certification notes:

1. The above model is permanently connected, Pollution Degree 2, Installation Category II.
2. Mode of operation: Continuous.
3. Environmental Conditions: Extended: -50°C to +70°C, 2000 m max, 0-95% rH as specified by manufacturer.

CSA Certificate 70054084X - Conditions of Acceptability:

1. When fitted with the 90V transient suppressors, the equipment is not capable of passing the 500V insulation test. This must be taken into account upon installation.
2. The process temperature shall be taken into consideration during installation, in order to ensure that the flowmeter transmitter ambient temperature rating of -50°C to +70°C (or -50°C to +60°C for Fieldbus) and T4 (135°C) classification are maintained. Elevated maximum process temperatures above the T-class entail remote mounting where the flow sensor is located outside of the T4 hazardous area.
3. Units marked with "Warning: Electrostatic Charging Hazard" may use non-conductive paint thicker than 0.2mm. Precautions shall be taken to avoid ignition due to electrostatic charge on the enclosure.
4. The enclosure may be made from aluminum alloy and given a protective polyurethane paint finish; however, care should be taken to protect it from impact or abrasion when located in Zone 0. The polyurethane paint finish may constitute an electrostatic hazard and must only be cleaned with a damp cloth.

CLASS 2258-04 - PROCESS CONTROL EQUIPMENT - Intrinsically Safe, Entity - For Hazardous Locations

CLASS 2258-84 - PROCESS CONTROL EQUIPMENT - Intrinsically Safe, Entity - For Hazardous Locations - Certified to US Requirements.

Vortex Flowmeter, Model 8600D with integral or remote mount flow sensor, with or without LCD meter, with or without transient protection, with or without temperature option (see model number structure below), permanently connected, with the Input / Entity Parameters tabulated below. When fitted with the Fieldbus Output Board and Fieldbus Terminal Board, the Input / Entity Parameters as tabulated below. The transmitter converts the sensor input to a 4-20 mA HART or Fieldbus (including FISCO) output, intrinsically safe when connected per drawing 08800-0112. The 8600D is rated "Dual Seal" up to a MWP 740PSI. Enclosure ratings: Type 4X, IP66. Ambient Temperature: -50°C to +70°C (HART), or -50°C to +60°C (Fieldbus). Process Temperature: -40°C to +232°C, see Conditions of Acceptability

Order Code IF

Class / Divisions:

IS with Entity: Class I, II, III Division 1, Groups A, B, C, D, E, F, G;
Non-incendive for Class I, Division 2, Groups A, B, C and D
Temperature Code T4: (-50 °C ≤ Ta ≤ 60 °C) Fieldbus/FISCO
Dual Seal up to MWP 740 PSI; Enclosure Type 4X; Install per drawing 08800-0112

Class / Zones:

Ex ia IIC T4 Ga
Class I, Zone 0, AEx ia IIC T4 Ga
Temperature Code T4: (-50 °C ≤ Ta ≤ 60 °C) Fieldbus/FISCO
Install per drawing 08800-0112, Dual Seal up to MWP 740 PSI; IP66

| 4-20 mA HART Input / Entity parameters | Fieldbus Input / Entity parameters | FISCO Input / Entity parameters |
|--|------------------------------------|---------------------------------|
| U _i = 30 VDC | U _i = 30 VDC | U _i = 17.5 VDC |
| I _i * = 185 mA | I _i * = 300 mA | I _i * = 380 mA |
| P _i * = 1.0 W | P _i * = 1.3 W | P _i * = 5.32 W |
| C _i = 0 μF | C _i = 0 μF | C _i = 0 μF |
| L _i = 0.97 mH | L _i = 20 μH | L _i < 10 μH |

* Total for transmitter

Combined North America Certifications K6: Combination of E6 and I6.

Model Number Structure:

8600D-abcdefghi Vortex Flowmeter

- a = Meter Style: F
 - b = Line Size: 010 (1.0 inch) up to 080 (8 inch)
 - c = Wetted Materials: S
 - d = Flange/Alignment Ring Code: Any two-digit alpha numeric characters
 - e = Sensor Process Temperature Range: N
 - f = Conduit Entry and Housing Material: 1 or 2
 - g = Transmitter Output: D, P, or F
 - h = Calibration: 0 or 1
 - i = Options: Any alpha-numeric characters representing product options up to forty-eight digits.
- Includes Safety Approval Code Options: **IF**, **I6** or **K6**

CSA Certification notes:



1. The above model is permanently connected, Pollution Degree 2, Installation Category II.
2. Mode of operation: Continuous.
3. Environmental Conditions: Extended: -50°C to +70°C, 2000 m max, 0-95% rH as specified by manufacturer.

CSA Certificate 70054084X - Conditions of Acceptability:

1. When fitted with the 90V transient suppressors, the equipment is not capable of passing the 500V insulation test. This must be taken into account upon installation.
2. The process temperature shall be taken into consideration during installation, in order to ensure that the flowmeter transmitter ambient temperature rating of -50°C to +70°C (or -50°C to +60°C for Fieldbus) and T4 (135°C) classification are maintained. Elevated maximum process temperatures above the T-class entail remote mounting where the flow sensor is located outside of the T4 hazardous area.
3. Units marked with "Warning: Electrostatic Charging Hazard" may use non-conductive paint thicker than 0.2mm. Precautions shall be taken to avoid ignition due to electrostatic charge on the enclosure.
4. The enclosure may be made from aluminum alloy and given a protective polyurethane paint finish; however, care should be taken to protect it from impact or abrasion when located in Zone 0. The polyurethane paint finish may constitute an electrostatic hazard and must only be cleaned with a damp cloth.

Rosemount 8600 Vortex Flow Meter ATEX / IECEx Flameproof Certifications

Flameproof enclosure 'Ex db' protection type in accordance with IEC 60079-1, EN 60079-1

-  Transmitters with Flameproof enclosure type protection shall only be opened when power is removed.
-  Closing of entries in the device must be carried out using the appropriate Ex d cable gland or blanking plug.
Housings with standard conduit entry thread forms are 1/2-14 NPT. Housings with optional thread form M20 x 1.5 are marked M20.

European Directive Information

The CE Declaration of Conformity for all applicable European directives for this product can be found on our website at www.emerson.com.
A hard copy may be obtained by contacting our local sales office.

ATEX Directive

Emerson Automation Solutions complies with the ATEX Directive.

Rosemount 8600 Vortex Flow Meter ATEX & IECEx Flameproof Certificate Summary

1. Equipment Markings – See individual certification information listed in this document
 - a. EU-Type Examination Certificates (ATEX):
DEKRA: DEKRA 12ATEX0189 X and Annex 1
 - b. Certificates of Conformity (IECEx):
DEKRA: IECEx DEK 11.0022X and Annex 1
2. Required Documentation:
 - a. 08600-AP02: Approval Document
3. Referenced Documentation:
 - a. 00809-0100-4860; 8600D Reference Manual.
 - b. 00825-0100-4860; 8600D Quick Start Guide.
 - c. 00809-0400-4004; 8800D Reference Manual (MODBUS)
 - d. 00825-0400-4004; 8800D Quick Start Guide (MODBUS)
4. The Required and Referenced Documents listed above address the following items:
 - a. Instructions for safety i.e.
 - i. Putting into service
 - ii. Use
 - iii. Assembling and dismantling
 - iv. Maintenance, overhaul and repair
 - v. Installation
 - vi. Adjustment
 - b. Where necessary, training instructions.
 - c. Details which allow a decision to be made as to whether the equipment can be used safely in the intended area under the expected operating conditions.
 - d. Electrical parameters, maximum surface temperatures and other limit values
 - i. Electrical – see table below and individual certification information listed in this document
 - ii. Other parameters - Refer to individual certification information listed in this document

| Rosemount 8600D Vortex Flow Meter: Electrical Input Ratings | |
|--|--|
| Power input | 42 VDC Max: 4-20 mA HART, digital Pulse; MODBUS RS-485 32 VDC Max; Fieldbus |
| Um | 250V |

- e. Special Conditions for Safe Use (X): see individual certificates listed in this document.
- f. Where necessary, the essential characteristics of tools which may be fitted to the equipment:
 - i. No proprietary tools required.
- g. List of the standards, including the issue date, with which the equipment is declared to comply:
 - i. See details of individual certificates listed in this document.
- h. Supply wire requirements: Use 24 AWG or larger wire and do not exceed 5,000 feet (1,500 meters). For ambient temperatures above 140 °F (60 °C) use wire rated to 176 °F (80 °C) or higher.
- i. Contact Address: Emerson – Rosemount, Micro Motion Inc
12001 Technology Drive
Eden Prairie, MN 55344 USA

European Certifications


ATEX Flameproof: Order Code; E1

Combined ATEX Certifications: Order Code K1 - Combination of Order Codes E1, I1, N1, and ND

Certificate: DEKRA12ATEX0189 X

Standards: EN IEC 60079-0: 2018 EN 60079-1: 2014 EN 60079-11: 2012 EN 60079-26: 2015

Markings:

| | | | |
|--------------------------------------|---|------------------------------|-----------------------|
| Integral Flowmeter marked: II 1/2 G |  | Ex db [ia] IIC T6...T2 Ga/Gb | (-50 °C ≤ Ta ≤ 70 °C) |
| Remote Transmitter marked: II 2(1) G | | Ex db [ia Ga] IIC T6 Gb | (-50 °C ≤ Ta ≤ 70 °C) |
| Remote Meter Body marked: II 1 G | | Ex ia IIC T6...T2 Ga | (-50 °C ≤ Ta ≤ 70 °C) |

CE 2460

EPL Ga piezo sensor and thermocouple connections.

EPL Gb transmitter enclosure.

See Annex 1 to ATEX / IECEx Flameproof Certificates for Electrical and Thermal Data

International IECEx Certifications

IECEx Flameproof: Order Code; E7

Combined IECEx Certifications: Order Code K7 - Combination of Order Codes E7, I7, N7, and NF.

Certificate: IECEx DEK 12.0022X

Standards: IEC 60079-0: 2017 IEC 60079-1: 2014 IEC 60079-11: 2011 IEC 60079-26: 2014

Markings:

| | | |
|----------------------------|------------------------------|-----------------------|
| Integral Flowmeter marked: | Ex db [ia] IIC T6...T2 Ga/Gb | (-50 °C ≤ Ta ≤ 70 °C) |
| Remote Transmitter marked: | Ex db [ia Ga] IIC T6 Gb | (-50 °C ≤ Ta ≤ 70 °C) |
| Remote Meter Body marked: | Ex ia IIC T6...T2 Ga | (-50 °C ≤ Ta ≤ 70 °C) |

EPL Ga piezo sensor and thermocouple connections.

EPL Gb transmitter enclosure.

See Annex 1 to ATEX / IECEx Flameproof Certificates for Electrical and Thermal Data

ATEX / IECEx Flameproof Certifications - Installation Instructions:

1. The cable and conduit entry devices shall be of a certified flameproof type Ex d, suitable for the conditions of use and correctly installed.
2. Unused apertures shall be closed with suitable blanking elements.
3. When the ambient temperature at the cable or conduit entries exceed 60 °C, cables suitable for at least 80 °C shall be used.
4. Remote mounted sensor; in type of protection Ex ia IIC, only to be connected to the associated Rosemount Model 8600D Vortex Flowmeter electronics. The maximum allowable length of the interconnecting cable is 152 m (500 ft).

ATEX / IECEx Flameproof Certifications - Special Conditions for Safe Use (X):

1. For information regarding the dimensions of the flameproof joints, the manufacturer shall be contacted.
2. The Flowmeter shall be provided with special fasteners of property class A2-70 or A4-70.
3. Units marked with "Warning: Electrostatic Charging Hazard" may use non-conductive paint thicker than 0.2 mm. Precaution shall be taken to avoid ignition due to electrostatic charge on the enclosure.
4. When the equipment is installed, precautions shall be taken to ensure the ambient temperature of the transmitter lies between -50°C to +70°C, taking into account process fluid effects. If the ambient temperature is outside this range remote transmitters shall be used.

Annex 1 to ATEX / IECEx Flameproof Certifications DEKRA 12ATEX0189 X and IECEx DEK 11.0022X

Thermal Data:

Ambient temperature range: -50 °C to +70 °C

Process temperature range: -50 °C to +250 °C

Temperature class – Transmitter: T6

Temperature class – Sensor: see table below

| Ambient temperature (°C) | Process temperature (°C) | T-Class sensor |
|--------------------------|--------------------------|----------------|
| -50 to +70 | -50 to +75 | T6 |
| -50 to +70 | -50 to +95 | T5 |
| -50 to +70 | -50 to +130 | T4 |
| -50 to +70 | -50 to +195 | T3 |
| -50 to +70 | -50 to +250 | T2 |

Electrical Data - Power Supply:

32 Vdc max (Fieldbus, digital output), Um = 250 V

42 Vdc max; (4-20 mA HART analog and pulse outputs; MODBUS),

Um = 250 V

Model Type Designation

8600D N 1 M M5 - V5
I II III IV V VI VII

| Designation | Explanation | Value | Explanation |
|-------------|------------------------------|-------|--|
| I | Model | 8600D | Vortex flowmeter |
| II | Sensor temperature range | N | Standard: -50 °C to +250 °C |
| III | Conduit entry | 1 | ½-14 NPT – aluminum housing |
| | | 2 | M20x1.5 – aluminum housing |
| | | 6 | ½-14 NPT – SST housing |
| | | 7 | M20x1.5 – SST housing |
| IV | Transmitter Output | D | 4-20 mA digital HART |
| | | P | 4-20 mA digital HART with pulse |
| | | F | FOUNDATION FIELDBUS |
| | | M | MODBUS RS-485 |
| V | Display | M5 | LCD display |
| | | Blank | No display |
| VI | Remote Electronics | R10 | 10 ft (3 m) cable |
| | | R20 | 20 ft (6.1 m) cable |
| | | R30 | 30 ft (9.1 m) cable |
| | | R33 | 33 ft (10 m) cable |
| | | R50 | 50 ft (15.2 m) cable |
| | | R75 | 75 ft (22.9 m) cable |
| | | Rxx | Customer specified cable length in feet ** |
| | | A10 | 10 ft (3 m) armored cable |
| | | A20 | 20 ft (6.1 m) armored cable |
| | | A33 | 33 ft (10 m) armored cable |
| | | A50 | 50 ft (15 m) armored cable |
| A75 | 75 ft (22.9 m) armored cable | | |
| Blank | Integral mount electronics | | |
| VII | Ground screw | V5 | External ground screw |


Note: * Other types of protection that appear on the marking of the equipment are not relevant to this certificate.

Note: ** Consult manufacturer for additional lengths up to 500 ft (152 m)

Rosemount 8600 Vortex Flow Meter

ATEX / IECEx Intrinsically Safe, Type 'n', and Enclosure (Ex tb - Dust) Certifications

Type 'n' protection type in accordance with IEC 60079-15, EN 60079-15

 Closing of entries in the device must be carried out using the appropriate Ex e or Ex n cable gland and metal blanking plug or any appropriate ATEX or IECEx approved cable gland and blanking plug with IP66 rating certified by an EU approved certification body.

European Directive Information

The CE Declaration of Conformity for all applicable European directives for this product can be found on our website at www.emerson.com.
A hard copy may be obtained by contacting our local sales office.

ATEX Directive

Emerson Automation Solutions complies with the ATEX Directive.

European Pressure Equipment Directive (PED)

Rosemount 8600D Vortex Flowmeter Line Size 40 mm to 200 mm

DNV GL Certificate Number 12317-2018-CE-USA-ACCREDIA

Module H Conformity Assessment

Mandatory CE-marking for flowmeters in accordance with Article 15 of the PED can be found on the flowtube body.

Flowmeter categories I – III use module H for conformity assessment procedures.

Rosemount 8600D Vortex Flowmeter Line Size 25 mm

Sound Engineering Practice (SEP)

Flowmeters that are SEP are outside the scope of PED and cannot be marked for compliance with PED.

Rosemount 8600 Vortex Flow Meter

ATEX / IECEx Intrinsically Safe, Type ‘n’, and Enclosure (Ex tb - Dust) Certifications

1. Equipment Markings – See individual certification information listed in this document
 - a. EU-Type and Type Examination Certificates (ATEX):
 Baseefa: Baseefa 12ATEX0179X, Baseefa 12ATEX0180X. Baseefa 17ATEX0019X
 - b. Certificates of Conformity (IECEx):
 Baseefa: IECEx BAS 12.0053X, IECEx BAS 12.0054X, IECEx BAS 17.0018X
2. Required Documentation:
 - a. None
3. Referenced Documentation:
 - a. 00809-0100-4860; 8600D Reference Manual.
 - b. 00825-0100-4860; 8600D Quick Start Guide.
 - c. 00813-0100-4860.pdf, 8600D Product Data Sheet
 - d. 00825-VA00-0011
4. The Required and Referenced Documents listed above address the following items:
 - a. Instructions for safety i.e.
 - i. Putting into service
 - ii. Use
 - iii. Assembling and dismantling
 - iv. Maintenance, overhaul and repair
 - v. Installation
 - vi. Adjustment
 - b. Where necessary, training instructions.
 - c. Details which allow a decision to be made as to whether the equipment can be used safely in the intended area under the expected operating conditions.
 - d. Electrical parameters, maximum surface temperatures and other limit values
 - i. Electrical – see table below and individual certification information listed in this document
 - ii. Other parameters - Refer to individual certification information listed in this document

| Rosemount 8600D Vortex Flow Meter: Electrical Input Ratings | |
|--|--|
| <i>Power input</i> | <i>42 VDC Max; 4-20 mA HART, digital Pulse</i> |
| <i>Um</i> | <i>250V</i> |

- e. Special Conditions for Safe Use (X): see individual certificates listed in this document.
- f. Where necessary, the essential characteristics of tools which may be fitted to the equipment:
 - i. No proprietary tools required.
- g. List of the standards, including the issue date, with which the equipment is declared to comply:
 - i. See details of individual certificates listed in this document.
- h. Supply wire requirements: Use 24 AWG or larger wire and do not exceed 5,000 feet (1,500 meters). For ambient temperatures above 140 °F (60 °C) use wire rated to 176 °F (80 °C) or higher.
- i. Contact Address:

Emerson – Rosemount, Micro Motion Inc
 12001 Technology Drive
 Eden Prairie, MN 55344 USA

European Certifications



ATEX Intrinsic Safety Certification: Order Code; I1

Combined ATEX Certifications: Order Code K1 - Combination of Order Codes E1, I1, N1, and ND

Certificate: Baseefa12ATEX0179X

Standards: EN IEC 60079-0: 2018 EN 60079-11: 2012

ATEX Marking

 II 1 G Ex ia IIC T4 Ga (-60 °C ≤ Ta ≤ 70 °C) 4-20 mA HART
 2460

| |
|--------------------------------|
| 4-20 mA HART entity parameters |
| U _i = 30 VDC |
| I _i * = 185 mA |
| P _i * = 1.0 W |
| C _i = 0 μF |
| L _i = 0.97 mH |

* Total for transmitter

Special Conditions for Safe Use (X):

1. When fitted with 90V transient suppressors (T1 option), the equipment is not capable of passing the 500V isolation test. This must be taken into account upon installation.
2. The enclosure may be made from aluminum alloy and given a protective polyurethane paint finish; however, care should be taken to protect it from impact or abrasion when located in Zone 0 environment. The polyurethane paint finish may constitute an electrostatic hazard and must only be cleaned with a damp cloth.
3. When the equipment is installed, particular precautions must be taken to ensure taking into account the effect of process fluid temperature, that the ambient temperature of the electrical housing of the equipment meets the marked protection type temperature range.

ATEX Type 'n' Certification: Order Code; N1

Combined ATEX Certifications: Order Code K1 - Combination of Order Codes E1, I1, N1, and ND

Certificate: Baseefa12ATEX0180X

Standards: EN IEC 60079-0: 2018 EN 60079-11: 2012 EN 60079-15: 2010

ATEX Marking

 II 3 G Ex nA ic IIC T5 Gc (-50 °C ≤ Ta ≤ 70 °C) 4-20 mA HART

Maximum Working Voltage = 42 VDC 4-20 mA HART

Special Conditions for Safe Use (X)

1. When fitted with 90V transient suppressors (T1 Option), the equipment is not capable of passing the 500V isolation test. This must be taken into account upon installation.
2. The enclosure may be made from aluminum alloy with a protective polyurethane paint finish. The polyurethane paint finish may constitute and electrostatic hazard and must only be cleaned with a damp cloth.
3. When the equipment is installed, particular precautions must be taken to ensure, taking into account the effect of process fluid temperature, that the ambient temperature of the electrical housing of the equipment meets the marked protection type temperature range.

ATEX Protection by Enclosure (Ex tb) (Dust) Certification: Order Code; ND

Combined ATEX Certifications: Order Code K1 - Combination of Order Codes E1, I1, N1, and ND

Certificate: BaseefaATEX17.0020X

Standards: EN IEC 60079-0: 2018 EN 60079-31: 2014

Certificate: Baseefa17ATEX0019X

ATEX Marking:



II 2 D

Ex tb IIIC T85°C Db (-20 °C ≤ Ta ≤ 70 °C)

CE 2460

Maximum Working Voltage = 42 VDC 4-20 mA HART

Special Conditions for Safe Use (X):

1. The enclosure may be made from aluminium alloy with a protective polyurethane paint finish which may constitute a potential electrostatic ignition risk. Care should be taken to protect it from external conditions conducive to the build-up of electrostatic charge on such surfaces. The enclosure must not be rubbed or cleaned with a dry cloth.
2. When the equipment is installed, particular precautions must be taken to ensure, taking into account the effect of process fluid temperature, that the ambient temperature of the electrical housing of the equipment meets the marked protection type temperature range.

IECEX International Certifications

IECEX Intrinsic Safety Certification: Order Code; I7

Combined IECEX Certifications: Order Code K7 - Combination of Order Codes E7, I7, N7, and NF

Certificate: IECEX BAS 05.0028X

Standards: IEC 60079-0: 2011 IEC 60079-11: 2011

IECEX Marking:

Ex ia IIC T4 Ga (-60 °C ≤ Ta ≤ 70 °C); 4-20 mA HART

| |
|--------------------------------|
| 4-20 mA HART entity parameters |
| U _i = 30 VDC |
| I _i * = 185 mA |
| P _i * = 1.0 W |
| C _i = 0 µF |
| L _i = 0.97 mH |

* Total for transmitter

Special Conditions for Safe Use (X):

1. When fitted with 90V transient suppressors (T1 Option), the equipment is not capable of passing the 500V isolation test. This must be taken into account upon installation.
2. The enclosure may be made from aluminum alloy and given a protective polyurethane paint finish; however, care should be taken to protect it from impact or abrasion when located in Zone 0 environment. The polyurethane paint finish may constitute an electrostatic hazard and must only be cleaned with a damp cloth.
3. When the equipment is installed, particular precautions must be taken to ensure, taking into account the effect of process fluid temperature, that the ambient temperature of the electrical housing of the equipment meets the marked protection type temperature range.

IECEX Type ‘n’ Certification: Order Code; N7

Combined IECEX Certifications: Order Code K7 - Combination of Order Codes E7, I7, N7, and NF

Certificate: IECEX BAS05.0029X

Standards: IEC 60079-0: 2011 IEC 60079-11: 2011 IEC 60079-15: 2010

IECEX Marking:

Ex nA ic IIC T5 Gc (-50 °C ≤ Ta ≤ 70 °C); 4-20 mA HART

Maximum Working Voltage = 42 VDC; 4-20 mA HART

Special Conditions for Safe Use (X):

1. When fitted with 90V transient suppressors (T1 Option), the equipment is not capable of passing the 500V isolation test. This must be taken into account upon installation.
2. The enclosure may be made from aluminum alloy with a protective polyurethane paint finish. The polyurethane paint finish may constitute an electrostatic hazard and must only be cleaned with a damp cloth.
3. When the equipment is installed, particular precautions must be taken to ensure, taking into account the effect of process fluid temperature, that the ambient temperature of the electrical housing of the equipment meets the marked protection type temperature range.

IECEX Protection by Enclosure (Ex tb) (Dust) Certification: Order Code; NF

Combined IECEX Certifications: Order Code K7 - Combination of Order Codes E7, I7, N7, and NF

Certificate: IECEX BAS 17.0019X

Standards: IEC 60079-0: 2017 IEC 60079-31: 2013

IECEX Marking:

Ex tb IIIC T85°C Db (-20 °C ≤ Ta ≤ 70 °C)

Maximum Working Voltage = 42 VDC 4-20 mA HART

Special Conditions for Safe Use (X):

1. The enclosure may be made from aluminium alloy with a protective polyurethane paint finish which may constitute a potential electrostatic ignition risk. Care should be taken to protect it from external conditions conducive to the build-up of electrostatic charge on such surfaces. The enclosure must not be rubbed or cleaned with a dry cloth.
2. When the equipment is installed, particular precautions must be taken to ensure, taking into account the effect of process fluid temperature, that the ambient temperature of the electrical housing of the equipment meets the marked protection type temperature range.



EU Declaration of Conformity No: RFD 1092 Rev. M

We,

**Emerson – Rosemount, Micro Motion Inc.
12001 Technology Drive
Eden Prairie, MN 55344
USA**

declare under our sole responsibility that the product(s),

Rosemount Model 8600D Vortex Flowmeters

to which this declaration relates, is in conformity with the provisions of the European Union Legislation, including the latest amendments, as shown in the attached schedule.

Assumption of conformity is based on the application of harmonized or applicable technical standards and, when applicable or required, a European Union Legislation notified body certification, as shown in the attached schedule.



(signature)

22 June 2022

(date of issue)

Mark Fleigle

(name - printed)

Vice President - Technology and Product Development

(function name - printed)



Schedule

EU Declaration of Conformity RFD 1092 Rev. M

EMC Directive 2014/30/EU:

All Models: EN 61326-1: 2013

PED Directive 2014/68/EU:

Model 8600D Vortex Flowmeter with option 'PD', in Line Sizes 1.5" (DN40) - 8" (DN200)

Equipment without the 'PD' option is NOT PED compliant and cannot be used in the EU without further assessment unless the installation is exempt under Article 1, paragraph 2 of the PED Directive 2014/68/EU.

QS Certificate of Assessment - 10000497900-PA-ACCREDIA-USA
Module H Conformity Assessment - ASME B31.3

Model 8600D Vortex Flowmeter, in Line Sizes: 1" (DN25)

Sound Engineering Practice - ASME B31.3

ATEX Directive 2014/34/EU: Model 8600D Vortex Flowmeter

Baseefa12ATEX0179 X – Intrinsic Safety Certificate

Equipment Group II, Category 1 G (Ex ia IIC T4 Ga)

EN 60079-0: 2018 EN 60079-11: 2012

Baseefa12ATEX0180 X – Type n Certificate

Equipment Group II, Category 3 G (Ex nA ic IIC T5 Gc)

EN 60079-0: 2018 EN 60079-11: 2012 EN 60079-15: 2010

Baseefa17ATEX0019X – Protection by Enclosure 'tb' Certificate

Equipment Group II, Category 2 D (Ex tb IIIC T85°C Db)

EN 60079-0: 2018 EN 60079-31: 2014

DEKRA 12ATEX0189 X – Flameproof with Intrinsically Safe Connection(s) Certificate

Equipment Group II, Category 1/2 G (Ex db [ia] IIC T6...T2 Ga/Gb) – Integral Transmitter

Equipment Group II, Category 2(1) G (Ex db [ia Ga] IIC T6 Gb) – Remote Transmitter

Equipment Group II, Category 1 G (Ex ia IIC T6...T2 Ga) – Remote Sensor

EN IEC60079-0:2018 EN 60079-1: 2014 EN 60079-11: 2012 EN 60079-26: 2015

RoHS Directive 2011/65/EU

All HART and MODBUS Models: EN 50581: 2012



Schedule
EU Declaration of Conformity RFD 1092 Rev. M

PED Notified Body

DNV GL Business Assurance S.r.l. [Notified Body Number: 0496]
Via Energy Park 14
Vimercate, 20871 Italy

ATEX Notified Bodies

SGS Fimko Oy [Notified Body Number: 0598]
Särkiniementie 3
P.O. Box 30, FI-00211
Helsinki, Finland

DEKRA Certification B. V. [Notified Body Number: 0344]
Meander 1051, 6825 MJ Arnhem
P.O. Box 5185, 6802 ED Arnhem
The Netherlands

ATEX Notified Body for Quality Assurance

DNV Nemko Presafe AS [Notified Body number: 2460]
P.O. Box 73, Blindern
0314 Oslo, Norway

Authorized Representative in Europe:

Emerson S.R.L., company No. J12/88/2006, Emerson 4 street, Parcul Industrial
Tetarom II, Cluj-Napoca 400638, Romania

Regulatory Compliance Shared Services Department
Email: europaeproductcompliance@emerson.com
Phone: +40 374 132 035

| PAGE | DESCRIPTION/PROTECTION TYPE |
|------|--|
| 1 | TABLE OF CONTENTS |
| 2 | NON-INCENDIVE FIELD WIRING |
| 3 | HART OUTPUT; INTRINSICALLY SAFE |
| 4 | FIELD BUS OUTPUT; INTRINSICALLY SAFE |
| 5 | FIELD BUS OUTPUT; INTRINSICALLY SAFE FISCO CONCEPT |
| 6 | FIELD BUS OUTPUT; NON-INCENDIVE CONCEPT FNICO CONCEPT |
| 7 | REPLACEMENT OF FM MARKED 8800D TRANSMITTERS WITH EQUIVALENT CSA MODEL CODE |
| 8 | Ex d - FLAMEPROOF INSTALLATION FOR CLASS I, ZONE 1. |

NOTES:

- COMPONENTS REQUIRED TO HAVE HAZARDOUS LOCATION APPROVAL MUST BE APPROVED FOR THE GAS GROUP APPROPRIATE TO AREA CLASSIFICATION.
- ASSOCIATED APPARATUS MANUFACTURER'S INSTALLATION DRAWING MUST BE FOLLOWED WHEN INSTALLING THIS EQUIPMENT.
- DUST-TIGHT CONDUIT SEAL MUST BE USED WHEN INSTALLED IN CLASS II AND CLASS III ENVIRONMENTS.
- TRANSMITTER MUST NOT BE CONNECTED TO EQUIPMENT GENERATING MORE THAN 250VAC.
- RESISTANCE BETWEEN INTRINSICALLY SAFE GROUND AND EARTH GROUND MUST BE LESS THAN 1 OHM.
- USA - INSTALLATION SHOULD BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC), NFPA-70, AND ANSI/ISA-RP12.06.01. "INSTALLATION OF INTRINSICALLY SAFE SYSTEMS FOR HAZARDOUS (CLASSIFIED) LOCATIONS" CANADA - INSTALLATION SHOULD BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE PART 1 (C22.1)
- THE ASSOCIATED APPARATUS MUST BE APPROVED FOR THE GAS GROUP APPROPRIATE TO AREA CLASSIFICATION.
- ⚠** WARNING - SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC AND NON-INCENDIVE SAFETY.

⚠ ASSOCIATED APPARATUS MUST MEET THE FOLLOWING PARAMETERS:

U_o or V_o or $V_t \leq U_i$ (Vmax) $C_a \geq$ THE SUM OF ALL C_i 's PLUS C_{cable}
 I_o or I_{sc} or $I_t \leq I_i$ (Imax) $L_a \geq$ THE SUM OF ALL L_i 's PLUS L_{cable}
 P_o or $P_{max} \leq (P_{max})$
- ⚠** WARNING - TO PREVENT IGNITION OF FLAMMABLE OR COMBUSTIBLE ATMOSPHERES, DISCONNECT POWER BEFORE SERVICING.

⚠ WARNING - IN EXPLOSIVE ATMOSPHERE KEEP TIGHT WHEN CIRCUIT ALIVE

⚠ AVERTISSEMENT: DANS UNE ATMOSPHERE EXPLOSIBLE GARDNER BIEN FERME LORSQUE LE CIRCUIT EST SOUS TENSION

⚠ WARNING - UNDERSTAND MANUAL BEFORE OPERATING

⚠ AVERTISSEMENT: LIRE ATTENTIVE LES INSTRUCTIONS AVANT DEMETTRE EN MARCHÉ
- THIS EQUIPMENT IS NOT CAPABLE OF PASSING THE 500V ISOLATION TEST DUE TO INTEGRAL TRANSIENT PROTECTION. THIS MUST BE TAKEN INTO ACCOUNT UPON INSTALLATION.
- WIRING METHOD SUITABLE FOR APPROPRIATE CLASS AND DIVISION OR ZONE AND PROTECTION TYPE.
- THE INTRINSICALLY SAFE 4-20MA OUTPUT MUST USE TWISTED PAIR WITH AN INDIVIDUAL SHIELD FOR THE PAIR. IT IS ALSO RECOMMENDED TO USE SHIELDED TWISTED PAIR FOR PULSE OUTPUT.
- NO REVISION TO THIS DRAWING WITHOUT PRIOR APPROVAL.

| REVISION TABLE | | | |
|----------------|----------|-------|--------|
| REVISION | ECO NO. | APP'D | DATE |
| AE | 1084-104 | M.M. | 7/2/18 |

DESCRIPTION

UPDATE PAGE 7 TABLE TO INCLUDE FM CODES IN CSA COLUMN. UPDATE PAGE 8.

08800-0112

DRAWING NO.

| | | | | | | | | | |
|---|---|---------|-------------|--------------|---|-------|---|-----|----|
| CONFIDENTIAL AND PROPRIETARY INFORMATION IS CONTAINED HEREIN AND MUST BE HANDLED ACCORDINGLY. | SURFACE FINISH UNLESS OTHERWISE SPECIFIED | 125° | 3RD ANGLE | SIZE | C | SCALE | - | REV | AE |
| <p>EMERSON INSTALLATION DRAWING FOR:</p> <p>TITLE: MODEL 8800D AND 8600D CSA IS INSTALLATION OR NON-INCENDIVE FIELD WIRING INSTALLATION APPROVAL FOR HART AND FIELD BUS</p> | | | | | | | | | |
| <p>UNLESS OTHERWISE SPECIFIED DIMENSIONS IN INCHES (mm). REMOVE ALL BURRS AND SHARP EDGES.</p> <p>-DEC TOLERANCES-</p> <p>.X ± .1 12.5I</p> <p>.XX ± .02 10.5I</p> <p>.XXX ± .010 10.25I</p> <p>FRACTIONS ANGLES</p> <p>± 1/32 ± 2°</p> | | | | | | | | | |
| DR. | N. BOND | 6-25-15 | DRAWING NO. | 08800-0112 | | | | | |
| APP'D | PRODUCT CODE | | DOC TYPE | SHEET 1 OF 8 | | | | | |


NONINCENDIVE FIELD WIRING

NONINCENDIVE FIELD WIRING
CLASS 1, DIV. 2 LOCATIONS

NON-CLASSIFIED
LOCATION

HAZARDOUS (CLASSIFIED) LOCATION
CLASS 1, DIV. 2, GRP'S A, B, C, D

V_{max1} C11 LI1
 V_{max2} C12 LI2
 V_{max3} C13 LI3
 V_{maxN} C1N LIN

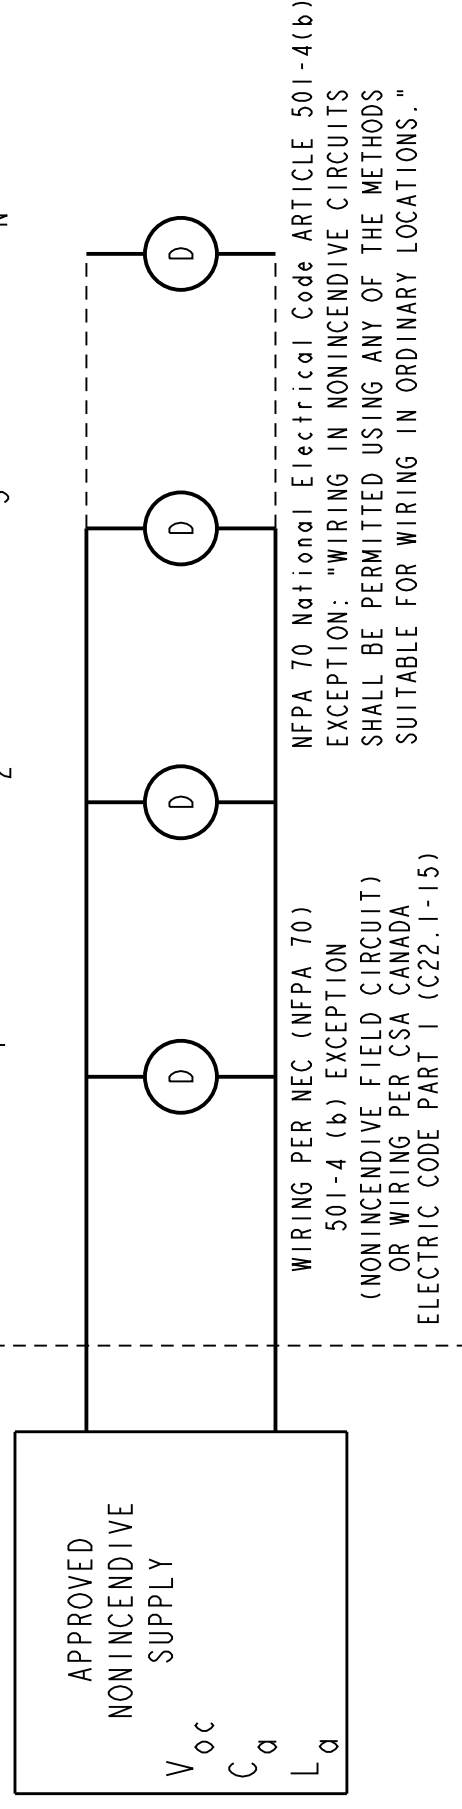

IN NORMAL OPERATION

DEVICES CONTROL THROUGH-CURRENT

PARAMETERS
(NON-INCENDIVE
FIELD WIRING)

| | |
|-------------------------------------|-------------|
| 8800D OR 8600D 4-20mA / HART | |
| V_{max} | 42.4V |
| MAXIMUM NORMAL OPERATING CURRENT | 22mA |
| C_i | 0 μ F |
| L_i | 970 μ H |

ROSEMOUNT 8800D OR 8600D TRANSMITTERS ARE CURRENT CONTROLLERS ON INDIVIDUAL PARALLEL BRANCHES WITH RESPECT TO THE POWER SUPPLY. IN NONINCENDIVE INSTALLATIONS THE I_{max} FOR EACH TRANSMITTER IS NOT RELATED TO THE MAXIMUM CURRENT OF THE POWER SUPPLY (I_{sc}) IN THE SAME MANNER AS FOR TRANSMITTER INSTALLED PER I.S. REQUIREMENTS, BECAUSE NONINCENDIVE REQUIREMENTS INCLUDE ONLY NORMAL OPERATING CONDITIONS.

$$I_{maxN} > = I_{qN} + I_{signalN}$$

$$I_{max} \text{ FOR AN INDIVIDUAL DEVICE} = I_q + I_{signal}$$

$$I_q = \text{QUIESCENT CURRENT THROUGH DEVICE}$$

(MAXIMUM QUIESCENT CURRENT FOR THE DEVICE)

$$I_{signal} = \text{SIGNALING CURRENT THROUGH DEVICE}$$

(PROTOCOL MAY LIMIT SIGNALING TO ONE DEVICE AT A TIME)

$$\text{OPERATING } I_{max} = I_{q1} + I_{q2} + \dots + I_{qN} + I_{signal} \text{ MAX}$$

$$I_{signal} \text{ MAX} = \text{MAX OF } (I_{signal1}, I_{signal2}, \dots, I_{signalN})$$

TEMP CODE: T4 ($T_a = +70^\circ\text{C}$)

CONFIDENTIAL AND PROPRIETARY
INFORMATION IS CONTAINED HEREIN
AND MUST BE HANDLED ACCORDINGLY.

UNLESS OTHERWISE SPECIFIED
DIMENSIONS IN INCHES (mm). REMOVE
ALL BURRS AND SHARP EDGES.

-DEC TOLERANCES-
.X \pm .1 (2.51)
.XX \pm .02 (0.51)
.XXX \pm .010 (0.251)
FRACTIONS ANGLES
 \pm 1/32 \pm 2'

SURFACE FINISH UNLESS
OTHERWISE SPECIFIED

125°

3RD ANGLE

SIZE C

SCALE -

REV AE

ROSEMOUNT

EMERSON

INSTALLATION DRAWING FOR:
MODEL 8800D OR 8600D CSA T.S. INSTALLATION OR
NON-INCENDIVE FIELD WIRING INSTALLATION
APPROVAL FOR HART AND FIELDBUS

DR. N. BOND 6-25-15 DRAWING NO.

08800-0112

DO NOT SCALE PRINT CAD MAINTAINED (PRO/E) PRODUCT CODE



SHEET 2 OF 8

(HART ONLY)

ROSEMOUNT MODEL 8800D OR 8600D CSA INTRINSIC SAFETY APPROVAL
 CIRCUIT CONNECTION WITH CSA APPROVED INTRINSIC SAFETY BARRIER(S).
 Ex ia
 INTRINSICALLY SAFE / SECURITE INTRINSEQUE

ENTITY PARAMETERS

| TERMINALS "+", "-", AND "4-20mA" | ASSOCIATED APPARATUS PARAMETERS |
|-------------------------------------|--|
| V _{max} = 30Vdc | V _{oc} OR V _t ≤ 30V |
| I _{max} = 185mA | I _{sc} OR I _t ≤ 185mA |
| C _i = 0uF | C _a > C _{cable} + C _i |
| L _i = 970uH | L _a > L _{cable} + L _i |

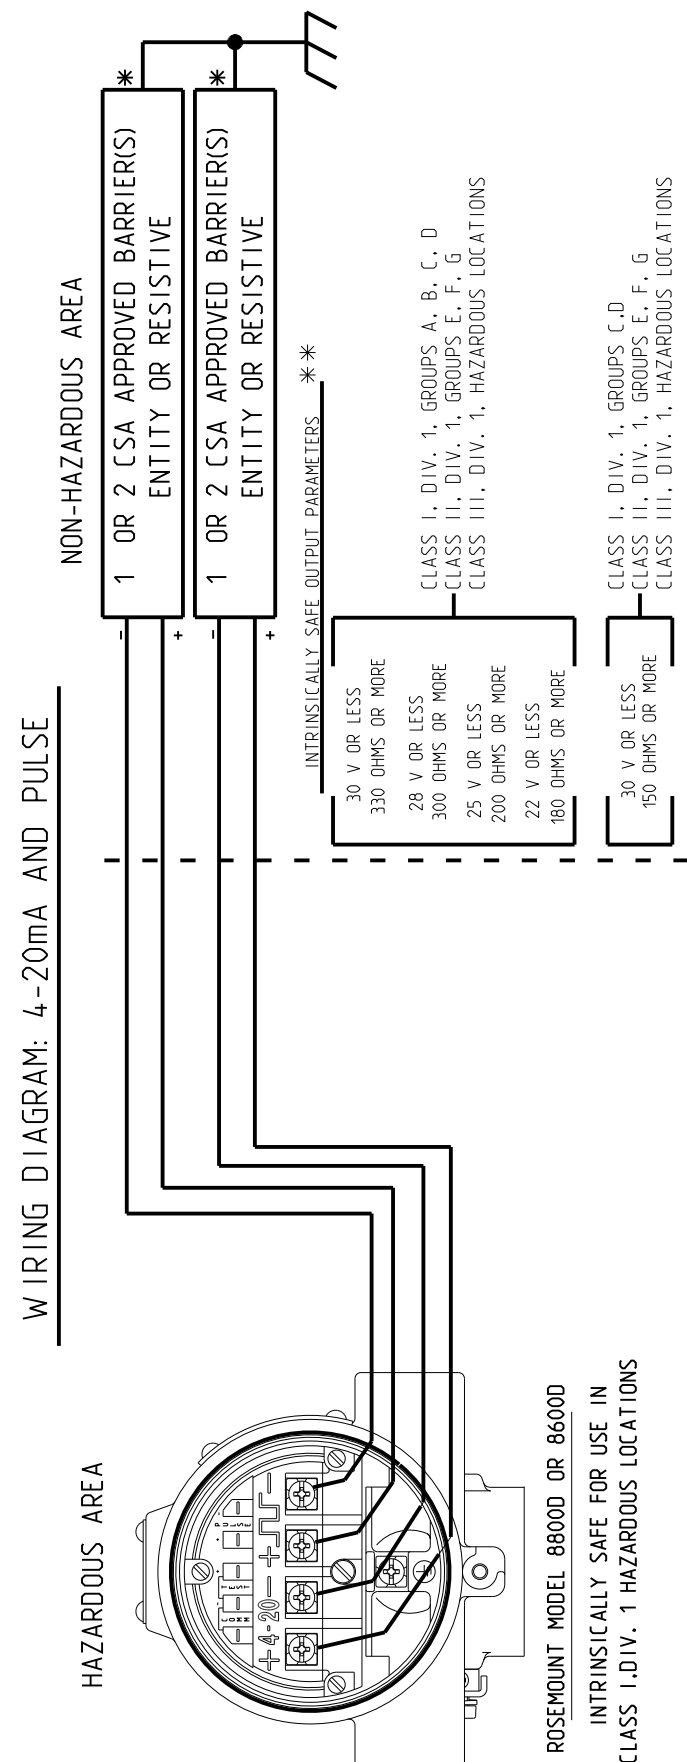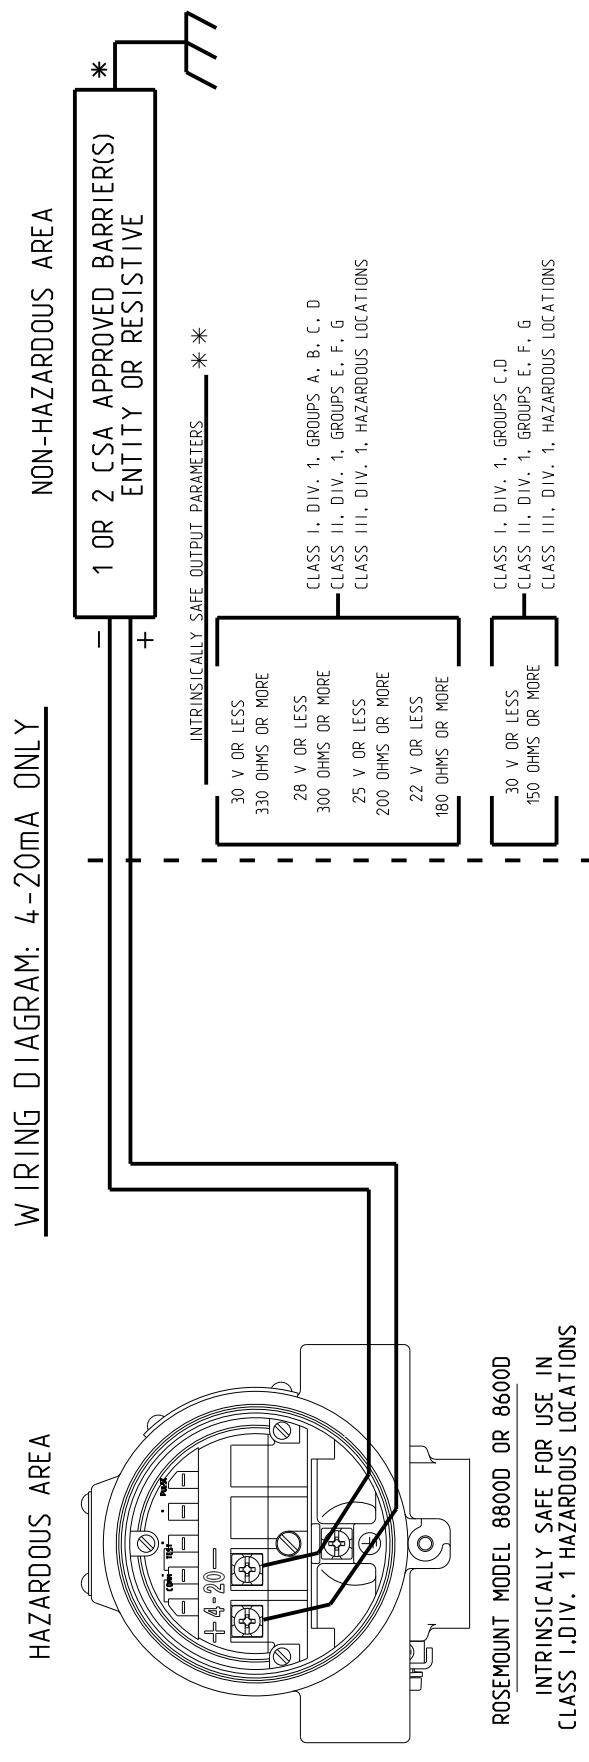

WARNING: SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY.
AVERTISSEMENT: La Substitution de composants peut compromettre la securite intrinseque.

SPECIAL CONDITIONS (X-CONDITIONS) FOR CLASS / ZONE INSTALLATIONS:

1. WHEN FITTED WITH 90V TRANSIENT SUPPRESSORS, THE EQUIPMENT IS NOT CAPABLE OF PASSING THE 500V INSULATION TEST. THIS MUST BE TAKEN INTO ACCOUNT UPON INSTALLATION.
2. THE ENCLOSURE MAY BE MADE FROM ALUMINUM ALLOY AND GIVEN A PROTECTIVE POLYURETHANE PAINT FINISH; HOWEVER, CARE SHOULD BE TAKEN TO PROTECT IT FROM IMPACT OR ABRASION WHEN LOCATED IN ZONE 0. THE POLYURETHANE PAINT FINISH MAY CONSTITUTE AN ELECTROSTATIC HAZARD AND MUST ONLY BE CLEANED WITH DAMP CLOTH.
3. WHEN THE EQUIPMENT IS INSTALLED, PARTICULAR PRECAUTIONS MUST BE TAKEN TO ENSURE, TAKING INTO ACCOUNT THE EFFECT OF PROCESS FLUID TEMPERATURE, THAT THE AMBIENT TEMPERATURE OF THE ELECTRICAL HOUSING OF THE EQUIPMENT MEETS THE MARKED PROTECTION TYPE TEMPERATURE RANGE.

HART INTRINSIC SAFETY

* ALL LINES CONNECTED TO THE MODEL 8800D OR 8600D MUST BE TERMINATED BY EITHER A CSA APPROVED BARRIER OR AN I.S. SAFETY GROUND.

* WHEN USING MORE THAN ONE CHANNEL OF A CSA APPROVED BARRIER, THE EFFECTIVE VOLTAGE AND RESISTANCE OF THE COMBINED LINES MUST COMPLY WITH THE LISTED INTRINSICALLY SAFE OUTPUT PARAMETERS. THE EFFECTIVE VOLTAGE AND RESISTANCE ARE TO BE CALCULATED AS FOLLOWS:

VOLTAGE: EFFECTIVE VOLTAGE = HIGHEST BARRIER VOLTAGE
 (NOTE: BOTH LINES MUST BE REFERENCED TO A COMMON GROUND)

RESISTANCE: EFFECTIVE RESISTANCE = PARALLEL COMBINATION OF EACH LINE
 (NOTE: DIODE RETURNS DO NOT NEED TO BE INCLUDED FOR THIS CALCULATION)

EXAMPLE #1:

BARRIER 1: VOLTAGE = 28V; RESISTANCE = 330 OHMS
 BARRIER 2: VOLTAGE = 28V; RESISTANCE = 330 OHMS
 EFFECTIVE VOLTAGE = 28V
 EFFECTIVE RESISTANCE = $R_1 R_2 / (R_1 + R_2) = 165$ OHMS

RESULT: THIS BARRIER COMBINATION WOULD BE ACCEPTABLE FOR GROUPS C, D SINCE THE EFFECTIVE VOLTAGE IS LESS THAN OR EQUAL TO 30V AND THE EFFECTIVE RESISTANCE IS GREATER THAN OR EQUAL TO 150 OHMS.

EXAMPLE #2:

BARRIER 1: VOLTAGE = 28V; RESISTANCE = 330 OHMS (4-20 "+")
 BARRIER 2: 28V DIODE RETURN (4-20 "-")
 BARRIER 3: VOLTAGE = 28V; RESISTANCE = 1000 OHMS (PULSE "+")
 BARRIER 4: 28V DIODE RETURN (PULSE "-")
 EFFECTIVE VOLTAGE = 28V
 EFFECTIVE RESISTANCE = $R_1 R_3 / (R_1 + R_3) = 248$ OHMS

RESULT: THIS BARRIER COMBINATION WOULD BE ACCEPTABLE FOR GROUPS C, D SINCE THE EFFECTIVE VOLTAGE IS LESS THAN OR EQUAL TO 30V AND THE EFFECTIVE RESISTANCE IS GREATER THAN OR EQUAL TO 150 OHMS.



WARNING: SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY.
AVERTISSEMENT: La Substitution de composants peut compromettre la securite intrinseque.

SPECIAL CONDITIONS (X-CONDITIONS) FOR CLASS / ZONE INSTALLATIONS:

1. WHEN FITTED WITH 90V TRANSIENT SUPPRESSORS, THE EQUIPMENT IS NOT CAPABLE OF PASSING THE 500V INSULATION TEST. THIS MUST BE TAKEN INTO ACCOUNT UPON INSTALLATION.
2. THE ENCLOSURE MAY BE MADE FROM ALUMINUM ALLOY AND GIVEN A PROTECTIVE POLYURETHANE PAINT FINISH; HOWEVER, CARE SHOULD BE TAKEN TO PROTECT IT FROM IMPACT OR ABRASION WHEN LOCATED IN ZONE 0. THE POLYURETHANE PAINT FINISH MAY CONSTITUTE AN ELECTROSTATIC HAZARD AND MUST ONLY BE CLEANED WITH DAMP CLOTH.
3. WHEN THE EQUIPMENT IS INSTALLED, PARTICULAR PRECAUTIONS MUST BE TAKEN TO ENSURE, TAKING INTO ACCOUNT THE EFFECT OF PROCESS FLUID TEMPERATURE, THAT THE AMBIENT TEMPERATURE OF THE ELECTRICAL HOUSING OF THE EQUIPMENT MEETS THE MARKED PROTECTION TYPE TEMPERATURE RANGE.

CONFIDENTIAL AND PROPRIETARY INFORMATION IS CONTAINED HEREIN AND MUST BE HANDLED ACCORDINGLY.

UNLESS OTHERWISE SPECIFIED DIMENSIONS IN INCHES (mm). REMOVE ALL BURRS AND SHARP EDGES.

-DEC TOLERANCES-
 .X ± .1 12.5I
 .XX ± .02 10.5I
 .XXX ± .010 10.25I
 FRACTIONS ANGLES
 ± 1/32 ± 2'

SURFACE FINISH UNLESS OTHERWISE SPECIFIED

125°

3RD ANGLE

SIZE

SCALE

REV

ROSEMOUNT

EMERSON

INSTALLATION DRAWING FOR:
 MODEL 8800D OR 8600D CSA I.S. INSTALLATION OR
 NON-INCENDIVE FIELD WIRING INSTALLATION
 APPROVAL FOR HART AND FIELDBUS

DR. N. BOND 6-25-15 DRAWING NO. 08800-0112


APP'D. 08800-0112

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE SHEET 3 OF 8

FIELDBUS INTRINSIC SAFETY

(FIELDBUS ONLY)

ROSEMOUNT MODEL 8800D OR 8600D CIRCUIT CONNECTION WITH CSA APPROVED INTRINSIC SAFETY BARRIER(S).
 Ex ia
 Intrinsically Safe/Securite Intrinsic

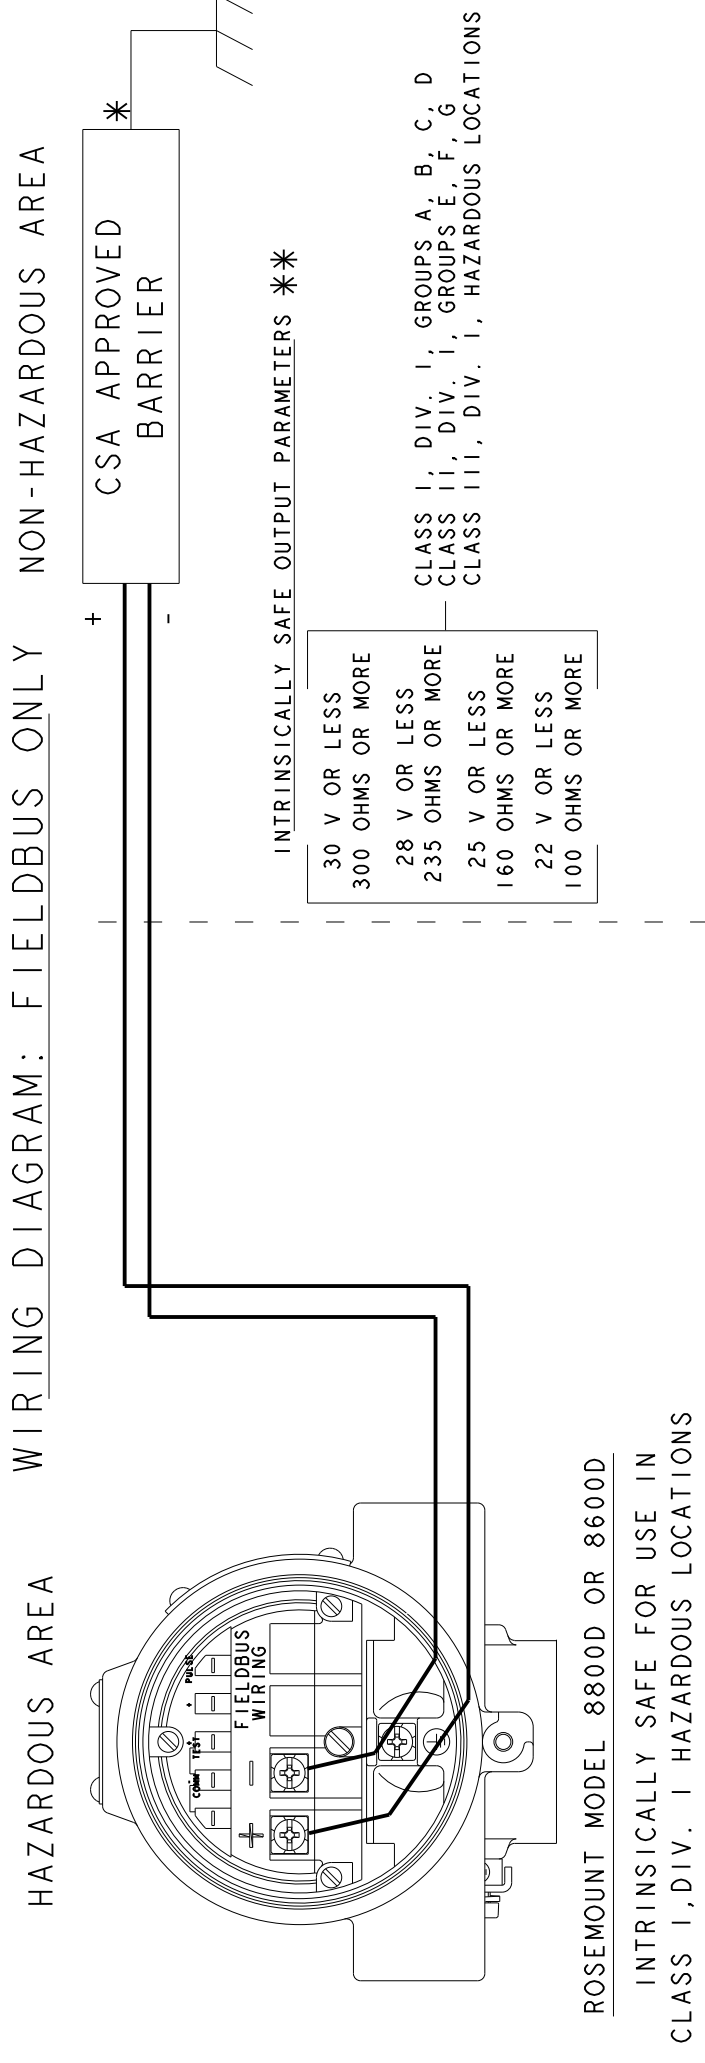

WARNING: SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY.
 AVERTISSEMENT: La Substitution de composants peut compromettre la securite intrinseque.

SPECIAL CONDITIONS (X-CONDITIONS) FOR CLASS / ZONE INSTALLATIONS:

1. WHEN FITTED WITH 90V TRANSIENT SUPPRESSORS, THE EQUIPMENT IS NOT CAPABLE OF PASSING THE 500V INSULATION TEST. THIS MUST BE TAKEN INTO ACCOUNT UPON INSTALLATION.
2. THE ENCLOSURE MAY BE MADE FROM ALUMINUM ALLOY AND GIVEN A PROTECTIVE POLYURETHANE PAINT FINISH; HOWEVER, CARE SHOULD BE TAKEN TO PROTECT IT FROM IMPACT OR ABRASION WHEN LOCATED IN ZONE 0. THE POLYURETHANE PAINT FINISH MAY CONSTITUTE AN ELECTROSTATIC HAZARD AND MUST ONLY BE CLEANED WITH DAMP CLOTH.
3. WHEN THE EQUIPMENT IS INSTALLED, PARTICULAR PRECAUTIONS MUST BE TAKEN TO ENSURE, TAKING INTO ACCOUNT THE EFFECT OF PROCESS FLUID TEMPERATURE, THAT THE AMBIENT TEMPERATURE OF THE ELECTRICAL HOUSING OF THE EQUIPMENT MEETS THE MARKED PROTECTION TYPE TEMPERATURE RANGE.

08800-0112

DRAWING NO.

REV
 AE

SCALE
 -

SIZE
 C

3RD ANGLE

SURFACE FINISH UNLESS OTHERWISE SPECIFIED

125°

EMERSON

ROSEMOUNT

INSTALLATION DRAWING FOR:
 MODEL 8800D OR 8600D CSA I.S. INSTALLATION OR
 NON-INCENDIVE FIELD WIRING INSTALLATION
 APPROVAL FOR HART AND FIELDBUS

DR. N. BOND 6-25-15 DRAWING NO. 08800-0112

APP'D.

DO NOT SCALE PRINT CAD MAINTAINED (PRO/E) PRODUCT CODE SHEET 4 OF 8

CONFIDENTIAL AND PROPRIETARY INFORMATION IS CONTAINED HEREIN AND MUST BE HANDLED ACCORDINGLY.

UNLESS OTHERWISE SPECIFIED DIMENSIONS IN INCHES (mm). REMOVE ALL BURRS AND SHARP EDGES.

-DEC TOLERANCES-

.X ± .1 12.51

.XX ± .02 10.51

.XXX ± .010 10.251

FRACTIONS ANGLES ± 1/32 ± 2'

FIELDBUS INTRINSIC SAFETY FISCO CONCEPT

FISCO CONCEPT

THE FISCO CONCEPT ALLOWS INTERCONNECTION OF INTRINSICALLY SAFE APPARATUS TO ASSOCIATED APPARATUS NOT SPECIALLY EXAMINED IN SUCH COMBINATION. THE CRITERIA FOR INTERCONNECTION IS THAT THE VOLTAGE (U_i OR V_{max}), THE CURRENT (I_i OR I_{max}), AND THE POWER (P_i OR P_{max}) WHICH AN INTRINSICALLY SAFE APPARATUS CAN RECEIVE AND REMAIN INTRINSICALLY SAFE CONSIDERING FAULTS, MUST BE EQUAL OR GREATER THAN VOLTAGE (U_o , V_{oc} , OR V_t), THE CURRENT (I_o , I_{sc} , OR I_t) AND THE POWER (P_o OR P_{max}) LEVELS WHICH CAN BE DELIVERED BY THE ASSOCIATED APPARATUS, CONSIDERING FAULTS AND APPLICABLE FACTORS. IN ADDITION, THE MAXIMUM UNPROTECTED CAPACITANCE (C_i) AND THE INDUCTANCE (L_i) OF EACH APPARATUS (OTHER THAN THE TERMINATION) CONNECTED TO THE FIELDBUS SEGMENT MUST BE LESS THAN OR EQUAL TO 5 nF AND 10 μ H RESPECTIVELY.

IN EACH SEGMENT ONLY ONE ACTIVE DEVICE, NORMALLY THE ASSOCIATED APPARATUS, IS ALLOWED TO PROVIDE THE NECESSARY ENERGY FOR THE FIELDBUS SYSTEM. THE VOLTAGE U_o (OR V_{oc} OR V_t) OF THE ASSOCIATED APPARATUS IS LIMITED TO 17.5VDC MAXIMUM. ALL OTHER EQUIPMENT CONNECTED TO THE BUS CABLE HAS TO BE PASSIVE, MEANING THAT THEY ARE NOT ALLOWED TO PROVIDE ENERGY TO THE SYSTEM, EXCEPT A LEAKAGE CURRENT OF 50 μ A FOR EACH CONNECTED DEVICE. SEPARATELY POWERED EQUIPMENT NEEDS GALVANIC ISOLATION TO ASSURE THAT THE INTRINSICALLY SAFE FIELDBUS CIRCUIT REMAINS PASSIVE.

THE CABLE USED TO INTERCONNECT DEVICES NEEDS TO HAVE THE PARAMETERS IN THE FOLLOWING RANGE:


| | |
|-------------------------------------|-----------------------------|
| Loop Resistance R_c : | 15.....150 Ohm/km |
| Inductance per unit length L_c : | 0.4.....1 mH/km |
| Capacitance per unit length C_c : | 45.....200 nF |
| Length of trunk cable: | less than or equal to 1000m |
| Length of spur cable: | less than or equal to 60m |

AT EACH END OF THE TRUNK CABLE AN APPROVED INFALLIBLE LINE TERMINATION WITH THE FOLLOWING PARAMETERS IS SUITABLE:

$$R = 90 \dots 102 \text{ Ohm}$$

$$C = 0 \dots 2.2 \mu\text{F}$$

ONE OF THE ALLOWED TERMINATIONS MIGHT ALREADY BE INTEGRATED IN THE ASSOCIATED APPARATUS. THE NUMBER OF PASSIVE APPARATUS CONNECTED TO THE BUS SEGMENT IS NOT LIMITED DUE TO I. S. REASONS. IF THE ABOVE RULES ARE RESPECTED, UP TO A TOTAL LENGTH OF 1000 m (SUM OF TRUNK AND ALL SPUR CABLES) OF CABLE IS PERMITTED. THE INDUCTANCE AND THE CAPACITANCE OF THE CABLE WILL NOT IMPAIR THE INTRINSIC SAFETY OF THE INSTALLATION.

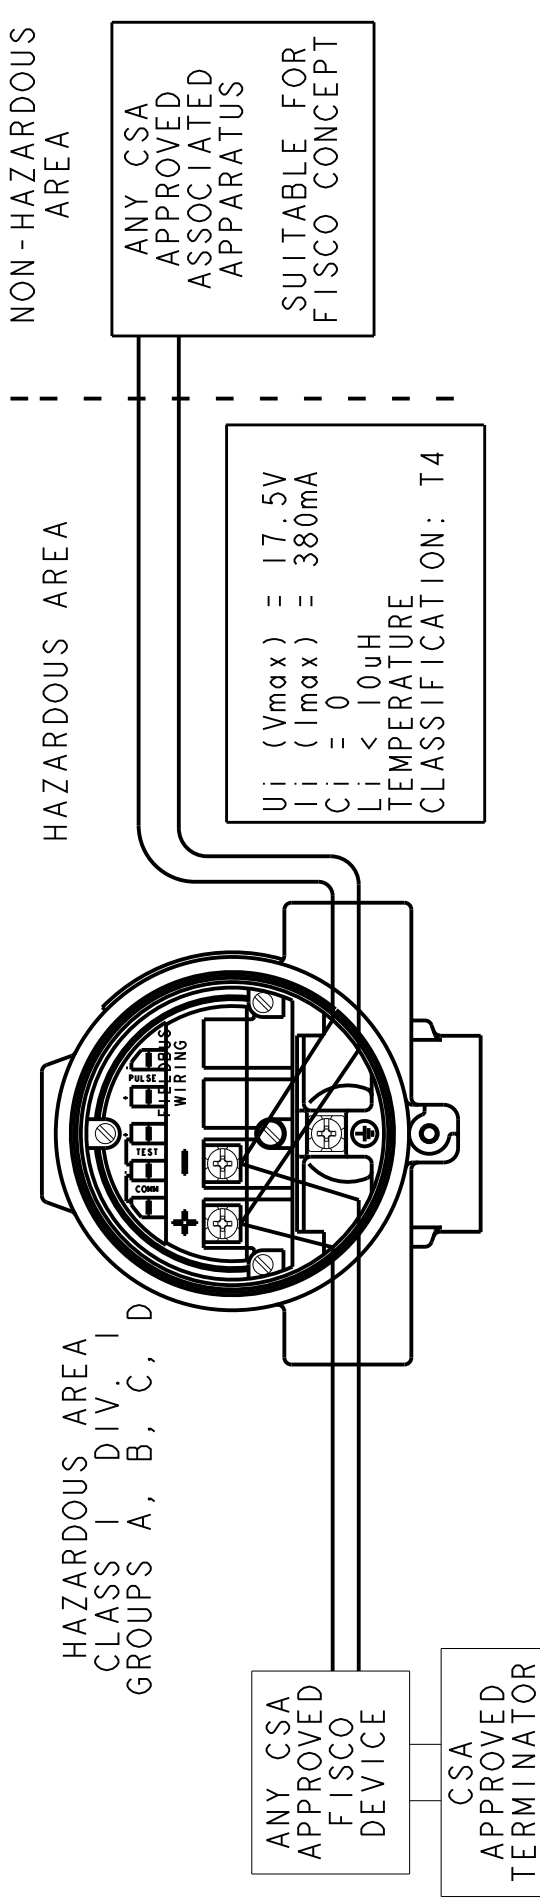

SPECIAL CONDITIONS (X-CONDITIONS) FOR CLASS / ZONE INSTALLATIONS:

1. WHEN FITTED WITH 90V TRANSIENT SUPPRESSORS, THE EQUIPMENT IS NOT CAPABLE OF PASSING THE 500V INSULATION TEST. THIS MUST BE TAKEN INTO ACCOUNT UPON INSTALLATION.
2. THE ENCLOSURE MAY BE MADE FROM ALUMINUM ALLOY AND GIVEN A PROTECTIVE POLYURETHANE PAINT FINISH; HOWEVER, CARE SHOULD BE TAKEN TO PROTECT IT FROM IMPACT OR ABRASION WHEN LOCATED IN ZONE 0. THE POLYURETHANE PAINT FINISH MAY CONSTITUTE AN ELECTROSTATIC HAZARD AND MUST ONLY BE CLEANED WITH DAMP CLOTH.
3. WHEN THE EQUIPMENT IS INSTALLED, PARTICULAR PRECAUTIONS MUST BE TAKEN TO ENSURE, TAKING INTO ACCOUNT THE EFFECT OF PROCESS FLUID TEMPERATURE, THAT THE AMBIENT TEMPERATURE OF THE ELECTRICAL HOUSING OF THE EQUIPMENT MEETS THE MARKED PROTECTION TYPE TEMPERATURE RANGE.

CONFIDENTIAL AND PROPRIETARY INFORMATION IS CONTAINED HEREIN AND MUST BE HANDLED ACCORDINGLY.

UNLESS OTHERWISE SPECIFIED DIMENSIONS IN INCHES (mm). REMOVE ALL BURRS AND SHARP EDGES.

| | |
|------------------|---------------|
| -DEC TOLERANCES- | |
| .X | ± .1 12.5I |
| .XX | ± .02 10.5I |
| .XXX | ± .010 10.25I |
| FRACTIONS | ANGLES |
| ± 1/32 | ± 2' |

EMERSON INSTALLATION DRAWING FOR:
MODEL 88000 OR 86000 CSA T.S. INSTALLATION OR NON-INCENDIVE FIELD WIRING INSTALLATION APPROVAL FOR HART AND FIELDBUS

ROSEMOUNT

DR. N. BOND 6-25-15 DRAWING NO. 08800-0112

APP'D. 08800-0112

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

DO NOT SCALE PRINT CAD MAINTAINED. (PRO/E) PRODUCT CODE

FIELDBUS NON-INCENDIVE FNICO CONCEPT

FNICO RULES

THE FIELDBUS NON-INCENDIVE CONCEPT ALLOWS INTERCONNECTION OF NON-INCENDIVE OR INTRINSICALLY SAFE APPARATUS IN DIVISION 2 TO ASSOCIATED APPARATUS NOT SPECIALLY EXAMINED IN SUCH COMBINATION. THE CRITERIA FOR INTERCONNECTION IS THAT THE VOLTAGE (V_{max}) WHICH THE NON-INCENDIVE OR INTRINSICALLY SAFE APPARATUS CAN RECEIVE MUST BE EQUAL OR GREATER THAN THE OUTPUT VOLTAGE (V_{oc}) WHICH CAN BE DELIVERED BY THE ASSOCIATED APPARATUS.

IN ADDITION, THE MAXIMUM UNPROTECTED CAPACITANCE (C_i) AND THE INDUCTANCE (L_i) OF EACH APPARATUS (OTHER THAN THE TERMINATION) CONNECTED TO THE FIELDBUS MUST BE LESS THAN OR EQUAL TO 5 nF AND 20 μ H RESPECTIVELY.

IN EACH SEGMENT ONLY ONE ACTIVE DEVICE, NORMALLY THE ASSOCIATED APPARATUS, IS ALLOWED TO PROVIDE THE NECESSARY ENERGY FOR THE FIELDBUS SYSTEM. THE VOLTAGE (V_{oc}) OF THE ASSOCIATED APPARATUS IS LIMITED TO A RANGE OF 14V TO 17.5Vd.c.. ALL OTHER EQUIPMENT CONNECTED TO THE BUS CABLE HAS TO BE PASSIVE, MEANING THAT THEY ARE NOT ALLOWED TO PROVIDE ENERGY TO THE SYSTEM, EXCEPT A LEAKAGE CURRENT OF 50 μ A FOR EACH CONNECTED DEVICE. SEPARATELY POWERED EQUIPMENT NEEDS GALVANIC ISOLATION BETWEEN ITS OWN SOURCE OF SUPPLY AND ITS FIELDBUS CONNECTIONS.

THE CABLE USED TO INTERCONNECT DEVICES NEEDS TO HAVE THE PARAMETERS IN THE FOLLOWING RANGE:


| | |
|-------------------------------------|-----------------------------|
| Loop Resistance R_c : | 15.....150 Ohm/km |
| Inductance per unit length L_c : | 0.4.....1 mH/km |
| Capacitance per unit length C_c : | 45.....200 nF/km |
| Length of trunk cable: | less than or equal to 1000m |
| Length of spur cable: | less than or equal to 60m |

AT EACH END OF THE TRUNK CABLE AN APPROVED INFALLIBLE LINE TERMINATION WITH THE FOLLOWING PARAMETERS IS SUITABLE:

$$R = 90.....102 \text{ Ohm}$$

$$C = 0.....2.2\mu\text{F}$$

ONE OF THE ALLOWED TERMINATIONS MIGHT ALREADY BE INTEGRATED IN THE ASSOCIATED APPARATUS. THE NUMBER OF PASSIVE APPARATUS CONNECTED TO THE BUS SEGMENT IS NOT LIMITED DUE TO I. S. REASONS. IF THE ABOVE RULES ARE RESPECTED, UP TO A TOTAL LENGTH OF 1000 m (SUM OF TRUNK AND ALL SPUR CABLES) OF CABLE IS PERMITTED. THE INDUCTANCE AND THE CAPACITANCE OF THE CABLE WILL NOT IMPAIR THE SAFETY OF THE INSTALLATION.

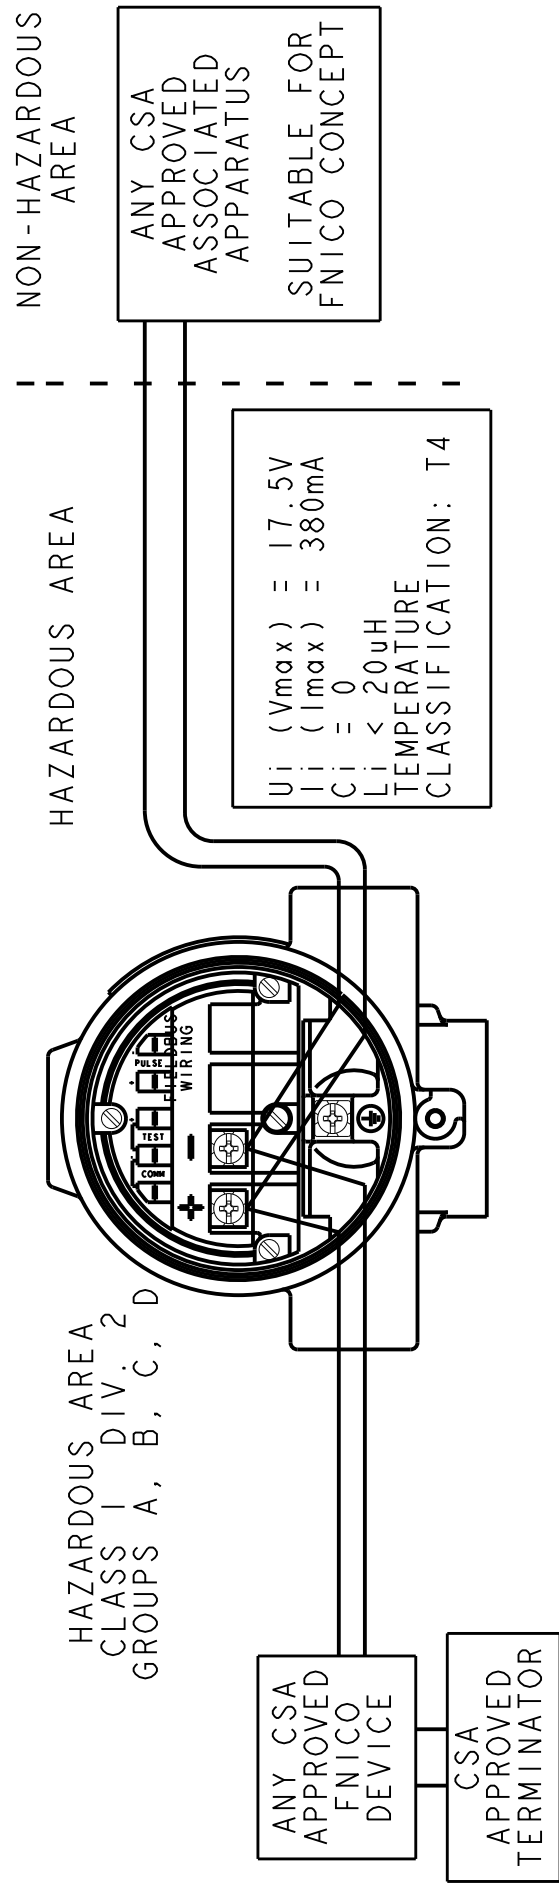

08800-0112

DRAWING NO.

| | | | | | | | | | |
|---|---|------------------|-----------|---------------------------|-------|--|-----|--------------------|--|
| CONFIDENTIAL AND PROPRIETARY INFORMATION IS CONTAINED HEREIN AND MUST BE HANDLED ACCORDINGLY. | SURFACE FINISH UNLESS OTHERWISE SPECIFIED | 125 | 3RD ANGLE | ✓ | SCALE | - | REV | AE | |
| | UNLESS OTHERWISE SPECIFIED DIMENSIONS IN INCHES (mm). REMOVE ALL BURRS AND SHARP EDGES. | -DEC TOLERANCES- | | .X ± .1 12.5I | | .XX ± .02 10.5I | | .XXX ± .010 10.25I | |
| EMERSON | | ROSEMOUNT | | INSTALLATION DRAWING FOR: | | MODEL 88000 OR 86000 CSA I.S. INSTALLATION OR NON-INCENDIVE FIELD WIRING INSTALLATION APPROVAL FOR HART AND FIELDBUS | | 08800-0112 | |
| TITLE | | N. BOND | | 6-25-15 | | DRAWING NO. | | 08800-0112 | |
| APP'D | | CAD MAINTAINED | | PRODUCT CODE | | DOC TYPE | | SHEET 6 OF 8 | |


| | | | | | | | | | | | |
|---------------|---|---|---|---|------------------|---|---|--|----|----|----|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
| A | B | C | D | E | F | G | H | REPLACEMENT OF FM MARKED 88000 TRANSMITTERS WITH EQUIVALENT CSA MODEL CODE | | | |
| APPROVAL CODE | | ORIGINAL MODEL | FM RATING | | APPROVAL CODE | CSA REPLACEMENT TRANSMITTER EQUIVALENCY | | | | | |
| I5 | | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D | | I5, I6, K6 OR KB | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D | | | | | |
| E5 | | EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | | E5, E6, K6 OR KB | EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | | | | | |
| IE | | FISCO INTRINSICALLY SAFE | FISCO INTRINSICALLY SAFE | | IE OR IF | FISCO INTRINSICALLY SAFE | | | | | |
| K5 | | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | | K5, K6 OR KB | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | | | | | |
| KB | | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | | K6 OR KB | INTRINSICALLY SAFE FOR CLASS I, II, III DIVISION 1 GROUPS A,B,C,D,E,F,G. NONINCENDIVE FOR CLASS I, DIVISION 2, GROUPS A,B,C,D EXPLOSION PROOF FOR CLASS I, DIV 1, GROUPS B, C, D DUST-IGNITION PROOF FOR Class II, III, Div 1, GROUPS E,F, G | | | | | |
| Blank | | Ordinary Locations | Ordinary Locations | | Blank | Ordinary Locations | | | | | |

08800-0112

DRAWING NO.

| | | | | | | |
|---|--|---------|--------------|----------|--------------|------------|
| CONFIDENTIAL AND PROPRIETARY INFORMATION IS CONTAINED HEREIN AND MUST BE HANDLED ACCORDINGLY. | SURFACE FINISH UNLESS OTHERWISE SPECIFIED | 125° | 3RD ANGLE | SIZE C | SCALE - | REV AE |
| UNLESS OTHERWISE SPECIFIED DIMENSIONS IN INCHES (mm). REMOVE ALL BURRS AND SHARP EDGES. | EMERSON | | ROSEMOUNT | | | |
| .X ± .1 12.5I .XX ± .02 10.5I .XXX ± .010 10.25I FRACTIONS ± 1/32 ANGLES ± 2' | TITLE INSTALLATION DRAWING FOR: MODEL 88000 OR 86000 CSA I.S. INSTALLATION OR NON-INCENDIVE FIELD WIRING INSTALLATION APPROVAL FOR HART AND FIELDBUS | | | | | |
| DO NOT SCALE PRINT | CAD MAINTAINED | (PRO/E) | PRODUCT CODE | DOC TYPE | SHEET 7 OF 8 | 08800-0112 |

Ex d - FLAMEPROOF INSTALLATIONS FOR CLASS I, ZONE 1

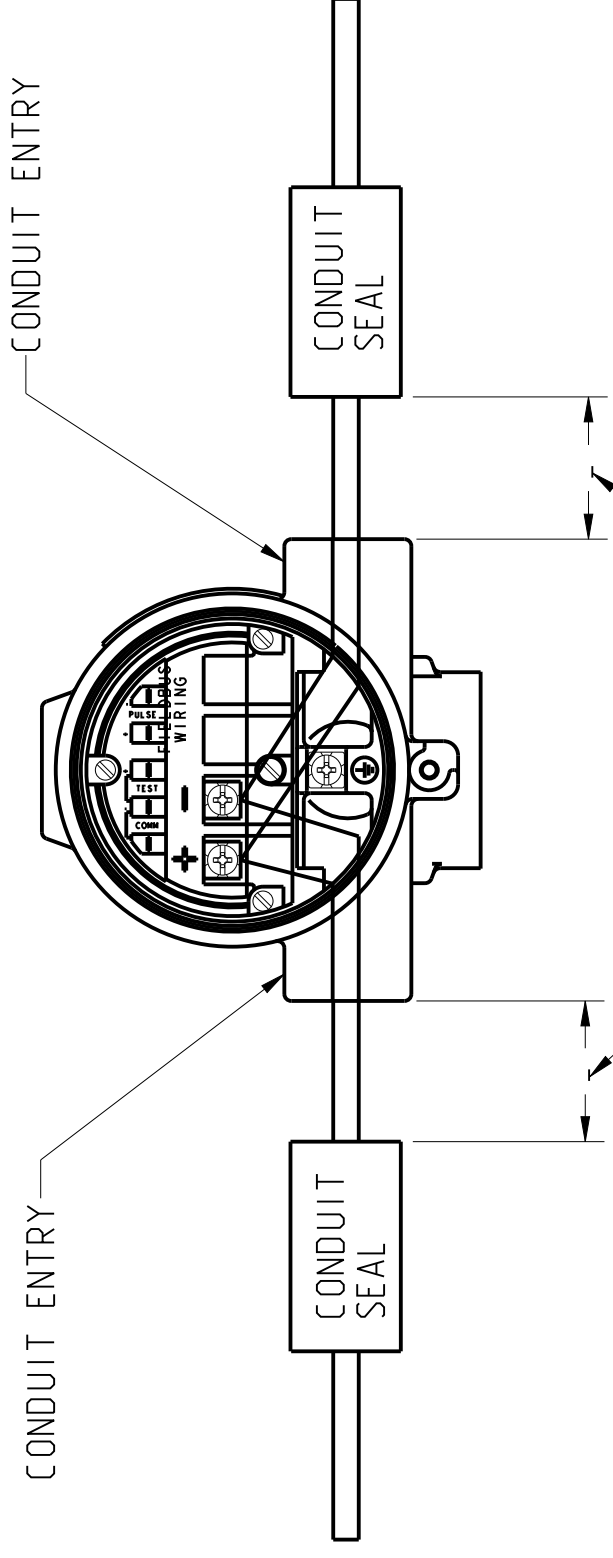

FOR Ex d INSTALLATIONS ONLY:
⚠ WARNING:
 A SEAL SHALL BE INSTALLED WITHIN 50mm OF THE ENCLOSURE
 UN SCÉLÈMENT DOIT ÊTRE INSTALLÉ À MOINS DE 50mm DUBOITIER

- SPECIAL CONDITIONS (X-CONDITIONS) FOR CLASS / ZONE INSTALLATIONS:
1. FOR INFORMATION REGARDING THE DIMENSIONS OF THE FLAMEPROOF JOINTS THE MANUFACTURER SHALL BE CONTACTED.
 2. THE FLOWMETER IS PROVIDED WITH SPECIAL FASTENERS OF PROPERTY CLASS A2-70 OR A4-70.
 3. UNITS MARKED WITH "WARNING: ELECTROSTATIC CHARGING HAZARD" MAY USE NON-CONDUCTIVE PAINT THICKER THAN 0.2mm. PRECAUTIONS SHALL BE TAKEN TO AVOID IGNITION DUE TO ELECTROSTATIC CHARGE ON THE ENCLOSURE.
 4. WHEN THE EQUIPMENT IS INSTALLED, PRECAUTIONS SHALL BE TAKEN TO ENSURE THE AMBIENT TEMPERATURE OF THE TRANSMITTER LIES BETWEEN -50°C TO +70°C, TAKING INTO ACCOUNT PROCESS FLUID EFFECTS. IF THE AMBIENT TEMPERATURE IS OUTSIDE THIS RANGE REMOTE TRANSMITTERS SHALL BE USED.

08800-0112

DRAWING NO.

| | | | | | | | |
|--|---|---------|-------------------------|-------------|--------------|------------|--------------|
| CONFIDENTIAL AND PROPRIETARY INFORMATION IS CONTAINED HEREIN AND MUST BE HANDLED ACCORDINGLY. UNLESS OTHERWISE SPECIFIED DIMENSIONS IN INCHES (mm). REMOVE ALL BURRS AND SHARP EDGES. -DEC TOLERANCES- .X ± .1 12.51 .XX ± .02 10.51 .XXX ± .010 10.251 FRACTIONS ± 1/32 ANGLES ± 2° | SURFACE FINISH UNLESS OTHERWISE SPECIFIED | 125° | 3RD ANGLE | | SIZE C | SCALE - | REV AE |
| | EMERSON TITLE ROSEMOUNT INSTALLATION DRAWING FOR: MODEL 88000 OR 86000 CSA T.S. INSTALLATION OR NON-INCENDIVE FIELD WIRING INSTALLATION APPROVAL FOR HART AND FIELDBUS | | | | | | |
| DR. N. BOND | | 6-25-15 | | DRAWING NO. | | 08800-0112 | |
| DO NOT SCALE PRINT | | | CAD MAINTAINED. (PRO/E) | | PRODUCT CODE | | SHEET 8 OF 8 |



For more information: www.emerson.com

©2021 Emerson. All rights reserved.
Emerson Terms and Conditions of Sale are available upon request. The Emerson logo is a trademark and service mark of Emerson Electric Co. Rosemount is a mark of one of the Emerson family of companies. All other marks are the property of their respective owners.
